

Removal of PFAS from drinking water by reverse osmosis membranes, residential filters, and a novel resin

Orlando Coronell¹, Frank Leibfarth², Detlef Knappe³, Heather Stapleton⁴

¹Department of Environmental Sciences and Engineering, Gillings School of Global Public Health, University of North Carolina at Chapel Hill

²Department of Chemistry, University of North Carolina at Chapel Hill

³Department of Civil, Construction and Environmental Engineering, North Carolina State University

⁴Nicholas School of the Environment, Duke University

Research Triangle Environmental Health Collaborative

12th Annual Environmental Health Summit

PFAS: Integrating Science and Solutions in NC

October 23-24, 2019

NC Biotech Center, RTP, NC



PFAST Team 3 Investigators



Orlando Coronell, PhD
Associate Professor
UNC, Chapel Hill



Mei Sun, PhD
Assistant Professor
UNC, Charlotte



Detlef Knappe, PhD
Professor, North
Carolina State
University



Frank Leibfarth, PhD
Assistant Professor
UNC, Chapel Hill



Heather Stapleton, PhD
Associate Professor
Duke University

Membrane treatment

Ion exchange treatment
Electrochemical treatment

Activated carbon
treatment

Novel resin treatment

Home filter treatment

PFAS removal by membrane filtration

Kasia Grzebyk¹, Nick Chew¹, Zachary Hopkins², Rebecca Weed², Detlef Knappe², Orlando Coronell¹

¹Department of Environmental Sciences and Engineering, University of North Carolina at Chapel Hill

²Department of Civil, Construction and Environmental Engineering, North Carolina State University

<http://lanxess.co.za/>




Motivation: The quantity and scope of studies evaluating PFAS rejection by high-pressure membranes is limited

Experimental design


Broad range of PFASs




Broad range of high-pressure membranes

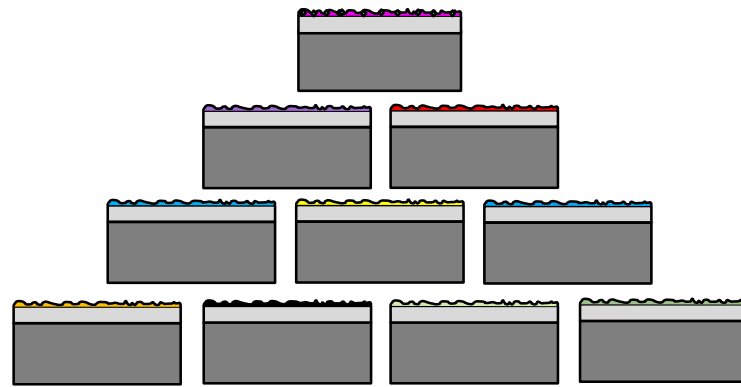

Various water matrices

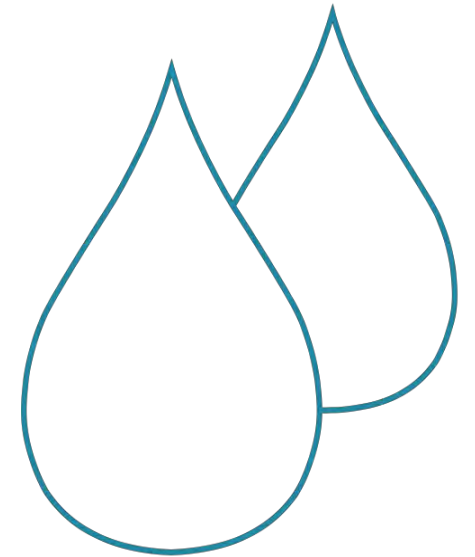

RO membranes consistently showed >90% PFAS removal
NF membranes showed often <90% PFAS removal

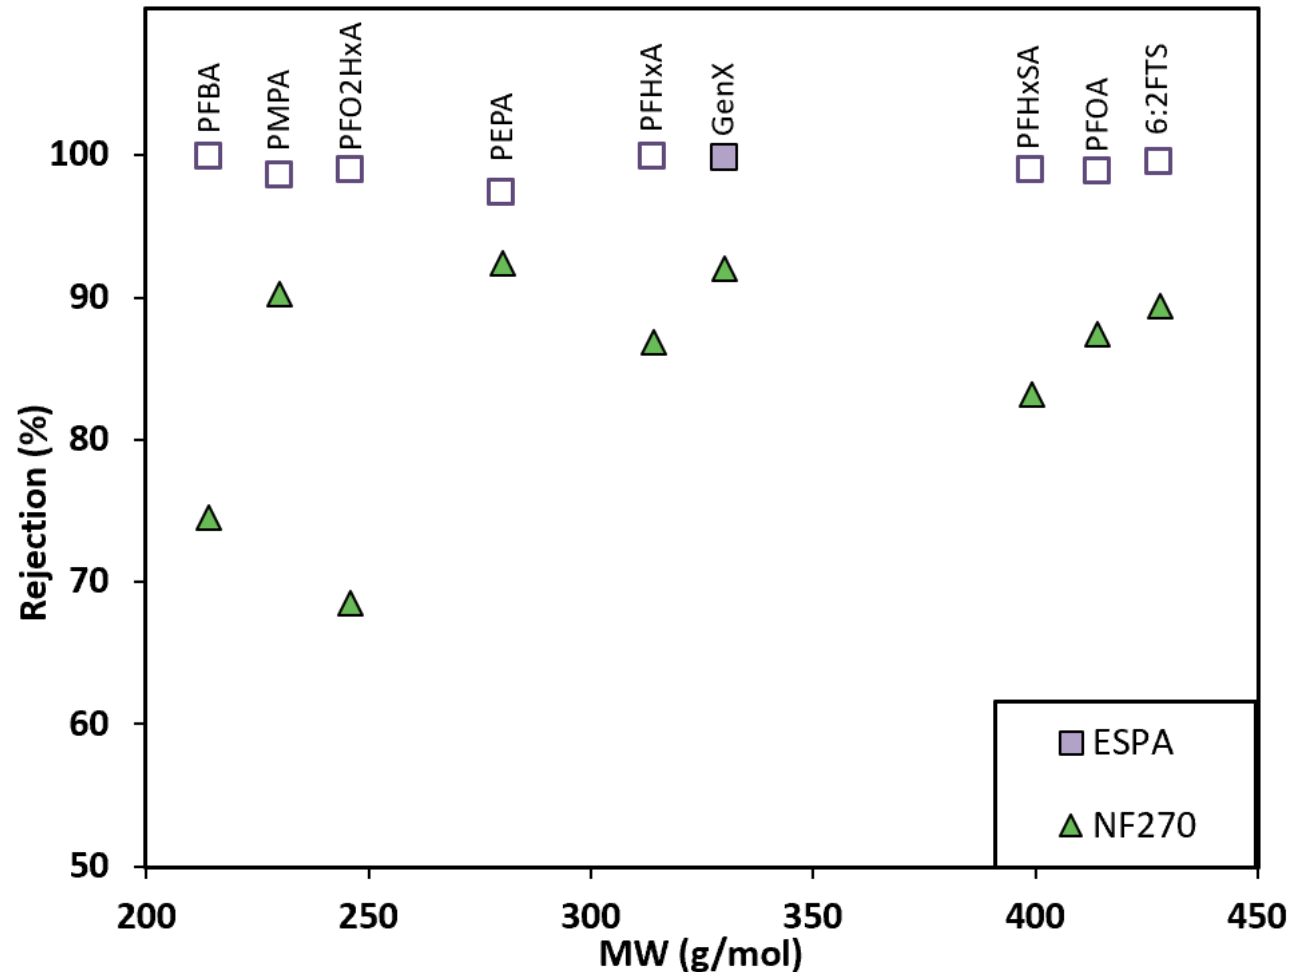

Residential reverse osmosis membranes

- Residential membranes performed as well as reverse osmosis membranes marketed for community/municipal water treatment
- Residential membranes showed PFAS removals greater than 97% for most PFAS species (e.g., PFBA, PMPA, PFO2HxA, PEPA, PFHxA, GenX, PFHxSA, PFOA, 6:2FTS)
- Changing the pressure of the feed water did not substantially impact the level of PFAS rejection by residential membranes

Ionic fluorogel resins for PFAS removal from water

Elango Kuramasamy¹, Irene Manning¹,
Orlando Coronell², Frank Leibfarth¹

¹Department of Chemistry, University of North Carolina at Chapel Hill

²Department of Environmental Sciences and Engineering, University of North Carolina at Chapel Hill




*Ionic Fluorogels
made in our lab*

Motivation: More effective resins (i.e., capacity and kinetics) are needed for the removal of PFAS from water


Ionic Fluorogel (IF) resins for PFAS remediation

Existing commercial materials do not adequately remove emerging, short-chain PFAS from water. We identified two approaches to create a synergistic PFAS removal strategy.

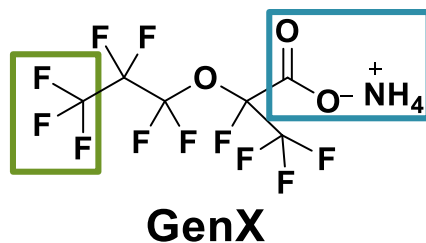

Fluorophilicity



- Allows separation of fluorinated compounds from complex media
- Has been shown to aid in PFOA sorption

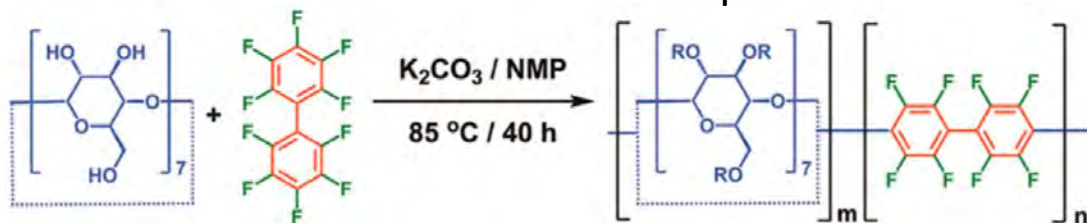

Ion Exchange

- State-of-the-art resin technology
- Relies on exchange of carboxylate group with a cationic resin (crosslinked polystyrene)
- Limited success for short-chain PFAS

IF resins show a higher affinity for PFAS than commercial technologies

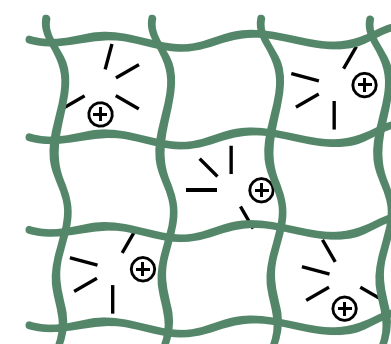
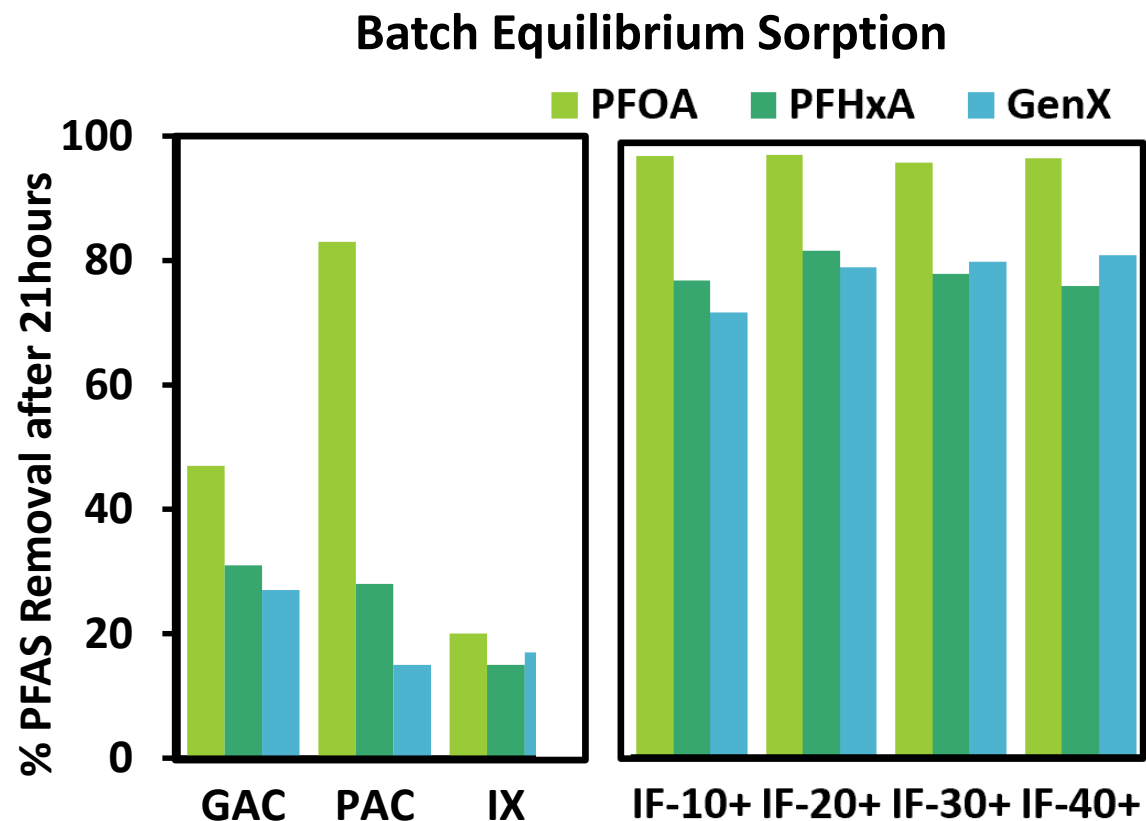


IF-X+


[Resin] = 10 mg/L
[PFAS]₀ = 1 μg/L
[NaCl] = 200 mg/L
[Humic Acid] = 20 mg/L
Equilibration time = 21 hours

GAC: Filtrasorb 400,
PAC: Picahydro MP23
IX: PFA 694E

IF resin has high GenX binding capacity and is amenable to regeneration

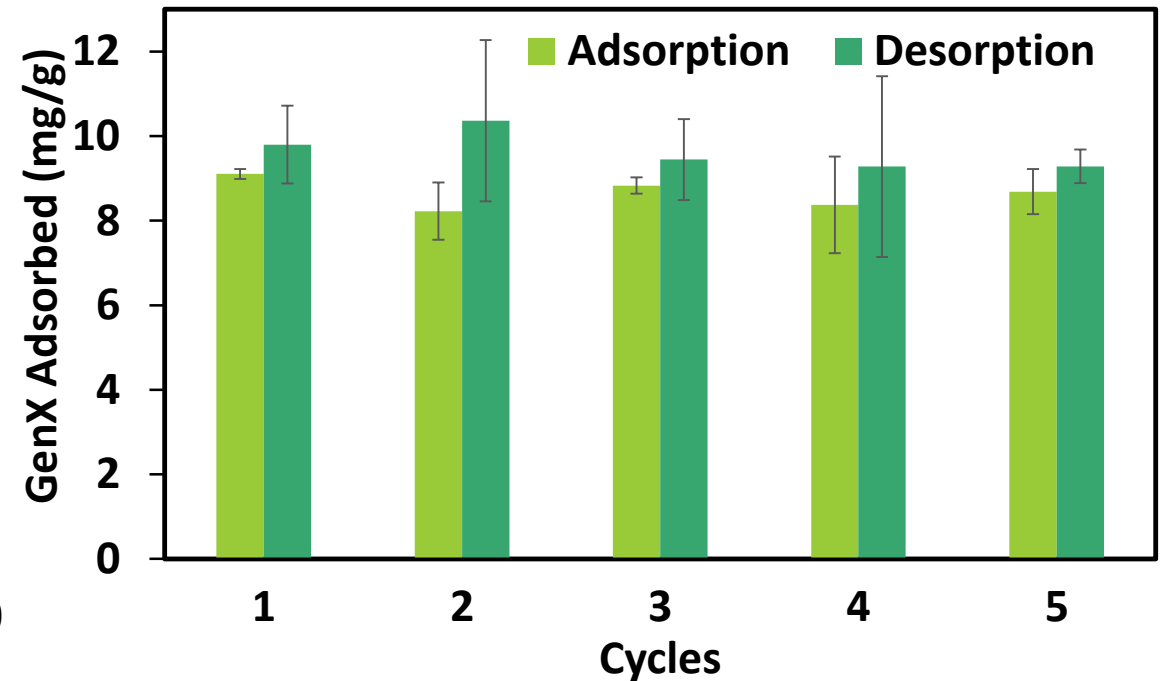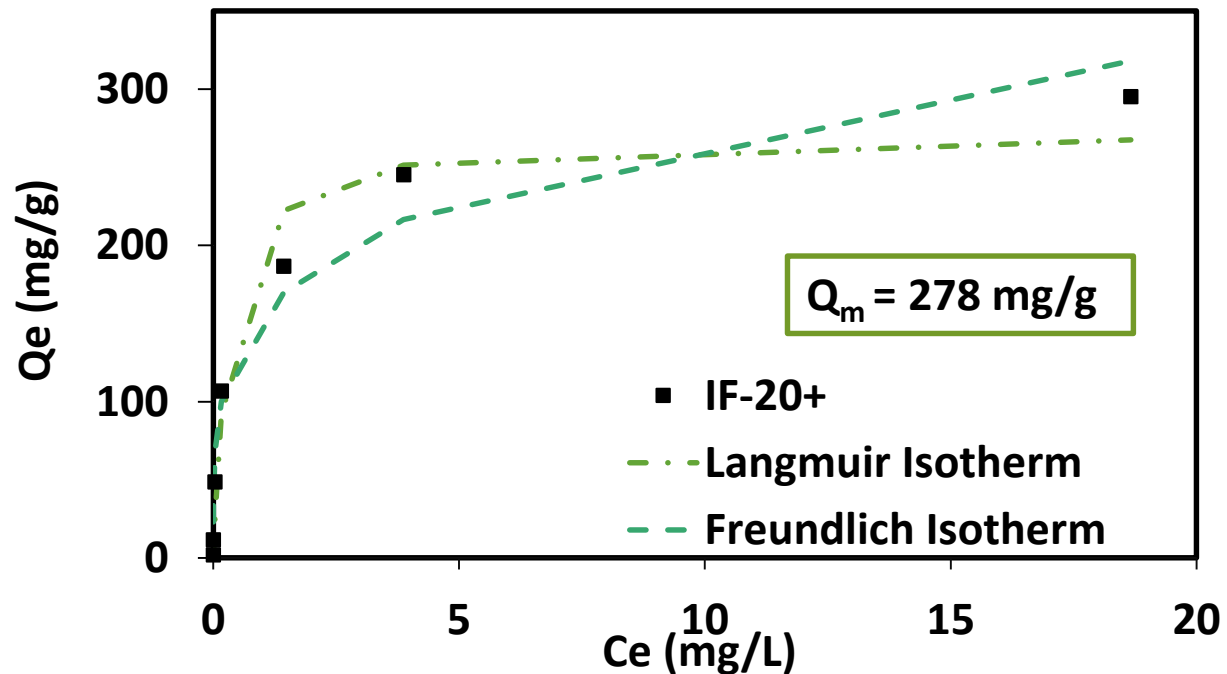

IF resin demonstrated high removal of 21 PFAS from settled surface water

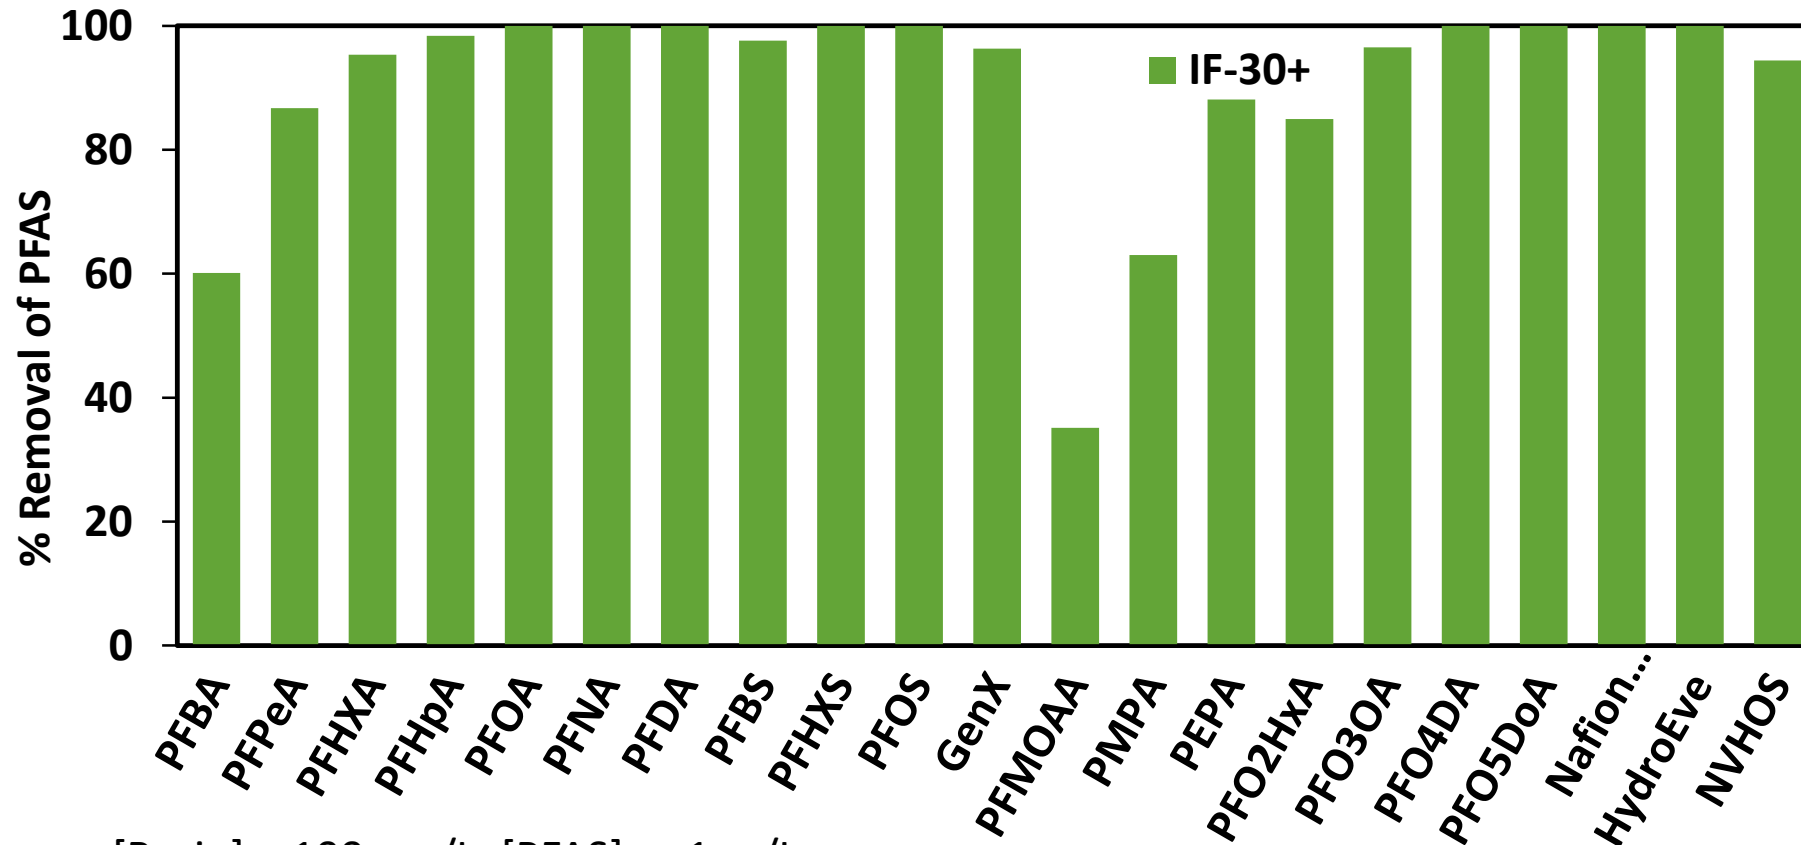

[Resin] = 100 mg/L; [PFAS]₀ = 1µg/L;
Equilibration time = 2 hours

E. Kumarasamy *et al.*, *ChemRxiv*. 2019, doi: 10.26434/chemrxiv.10046576.v1

PFAS removal by point-of-use residential water filters

Nicholas J. Herkert¹, Cara Peters¹, David Bollinger¹, Sharon Zhang¹, Detlef R. U. Knappe², Kate Hoffman¹, P. Lee Ferguson¹, Heather M. Stapleton¹

¹ Nicholas School of the Environment, Duke University

² Department of Civil, Construction and Environmental Engineering, North Carolina State University




Motivation: The quantity and scope of studies evaluating PFAS rejection by POU residential water filters is limited


Herkert et al. under review

Experimental design

- **Participants:** Interested homeowner residing in Chatham, Durham, Orange and Wake counties
- **Samples Collected:**
 - A 1L water sample from a faucet in the home with no in-line filtration
 - A 1 L water sample will be collected from the owner's source of filtered water
 - A written survey to collect information on home's water source and drinking water habits
- **Samples Analysis:** Analyzed for a suite of 11 perfluorinated chemicals (PFCs)

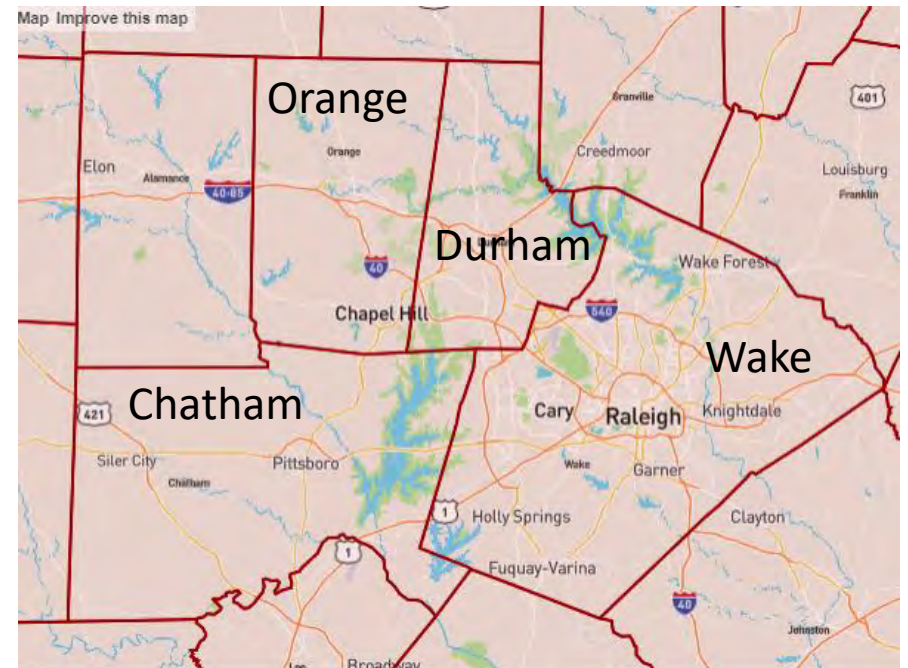

PFAS concentrations in sampled areas

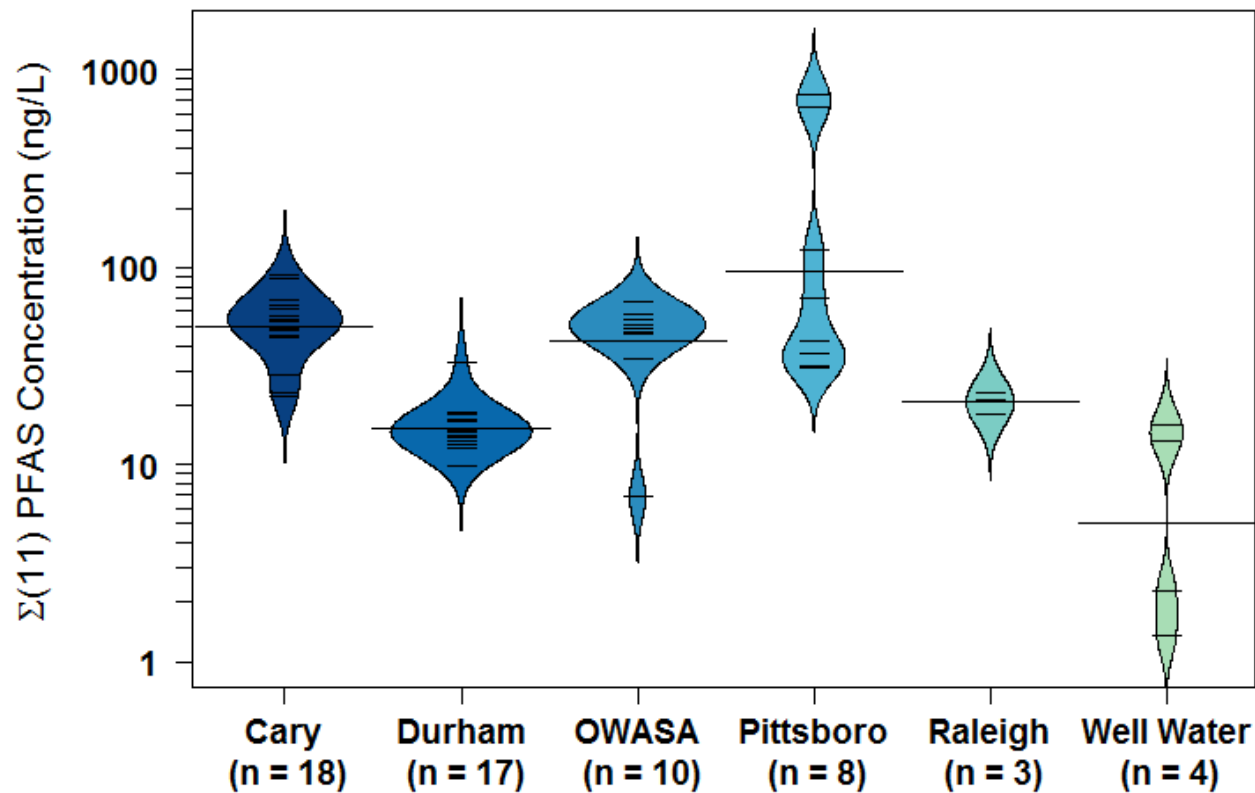

Source water concentrations for different water utilities. On average the $\Sigma(11)$ PFAS across all water utilities was 62 ng L^{-1} and ranged from 7 ng L^{-1} to 729 ng L^{-1} .

PFAS removal via POU Filters

- All reverse osmosis and dual-stage filters had near complete PFAS removal.
- Activated Carbon based filters demonstrated much greater variability across our study.
 - Single stage under-sink filters (n=5) removed a majority of PFASs (% removal > 84%) but only removed half of PFCAs.
 - Both refrigerator (R) and pitcher (P) filter showed increased removal efficiency for long-chain PFAAs (61% for P & 65% for R) compared to short-chain PFAAs (46% for P & 47% for R).
 - Whole house POE system were largely ineffective and 4 of 6 POE systems showed increase in concentration after filtration.



Refrigerator Filter



Pitcher Filter



Reverse osmosis

Herkert et al. under review

PFAS removal correlated well with chain length

- Long-chain PFAS compounds we removed more efficiently than short-chain PFAS compounds.
- Statistically significant (p -value < 0.05) positive correlation between average percent removal by AC filters and chain length for **PFCAs**
- Suggestive correlation between average percent removal by AC filters and chain length for **PFSAs**, though not statistically significant.



Refrigerator Filter



Pitcher Filter